



HVAC UNIT suspended from RW30N Hangers and restrained by SCB Cable Assemblies in four corners. SAFEFLEX Expansion Joints are installed in pipelines to reduce blade frequency vibration and noise and to allow for seismic displacement.

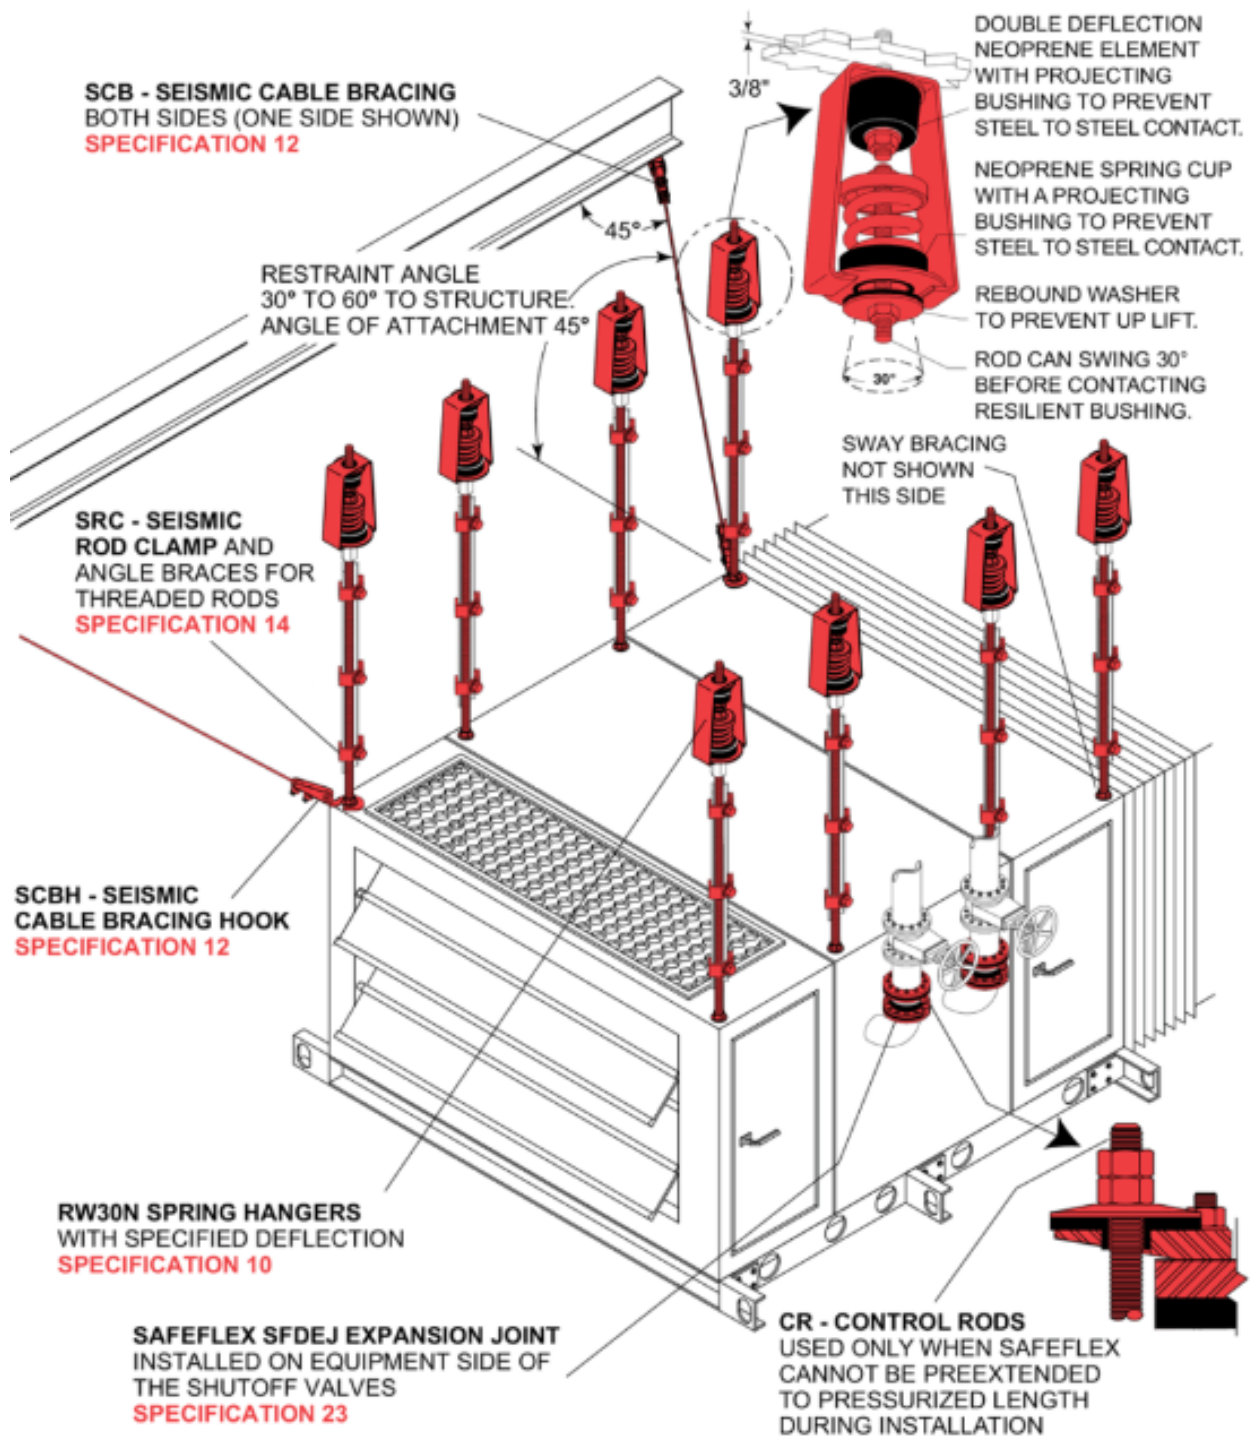

HVAC UNIT on steel base with height saving brackets, high deflection SLF Spring Mounts and Z-1011 Seismic Restraints. Reinforced housekeeping pad secured by HPA Anchors. SAFEFLEX Expansion Joints are installed in pipelines to reduce blade frequency vibration and noise and to allow for seismic displacement.

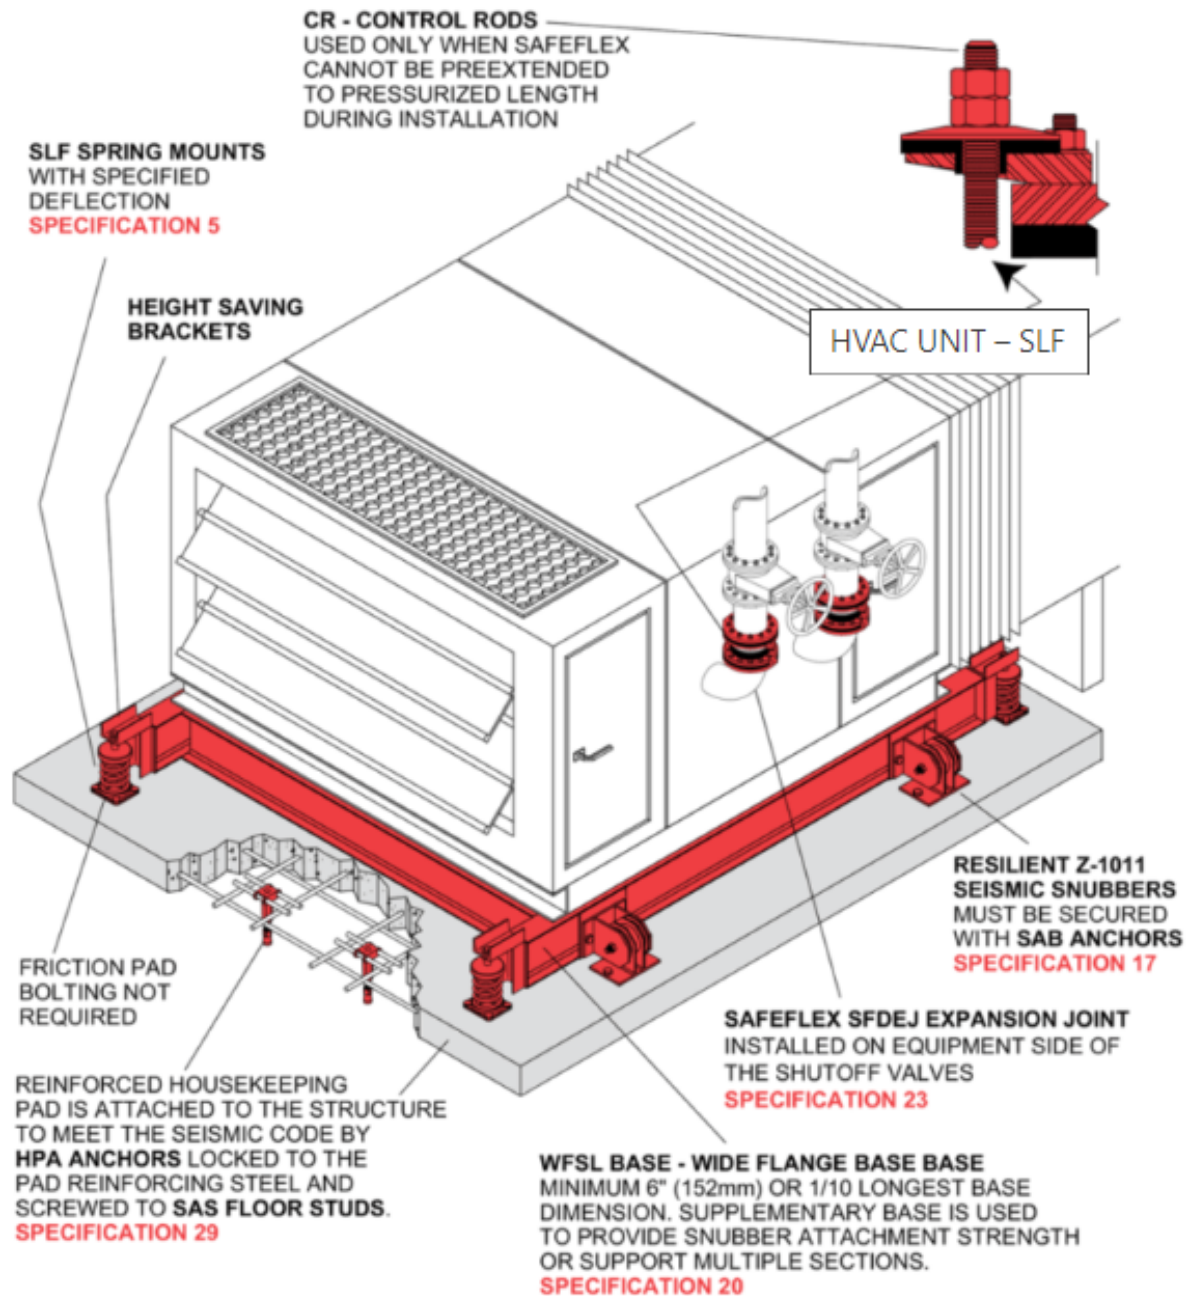

HVAC UNIT directly mounted on 1" deflection SSLFH Spring Mounts. Reinforced housekeeping pad secured by HPA Anchors. SAFEFLEX Expansion Joints are installed in pipelines to reduce blade frequency vibration and noise and to allow for seismic displacement.

